



INSTALLATION NOTES:

1. CONDUIT SHALL SWEEP INTO JUNCTION BOX FROM 24" - 30" DEPTH OF COVER.
2. CONDUIT ENDS SHALL BE SWEEP UP A MIN. OF 4" AND CAPPED OR COVERED TO PREVENT DEBRIS FROM ENTERING.
3. JUNCTION BOX SHALL BE INSTALLED ON 6" MIN. LAYER OF COMPACTED 3/4"-0 CRUSHED AGGREGATE.
4. JUNCTION BOX SHALL BE INSTALLED PARALLEL AND PERPENDICULAR TO ADJACENT CONCRETE STRUCTURES UNLESS OTHERWISE APPROVED.
5. MULE TAPE AND #10 AWG TRACER WIRE TO BE INSTALLED BY CONTRACTOR.

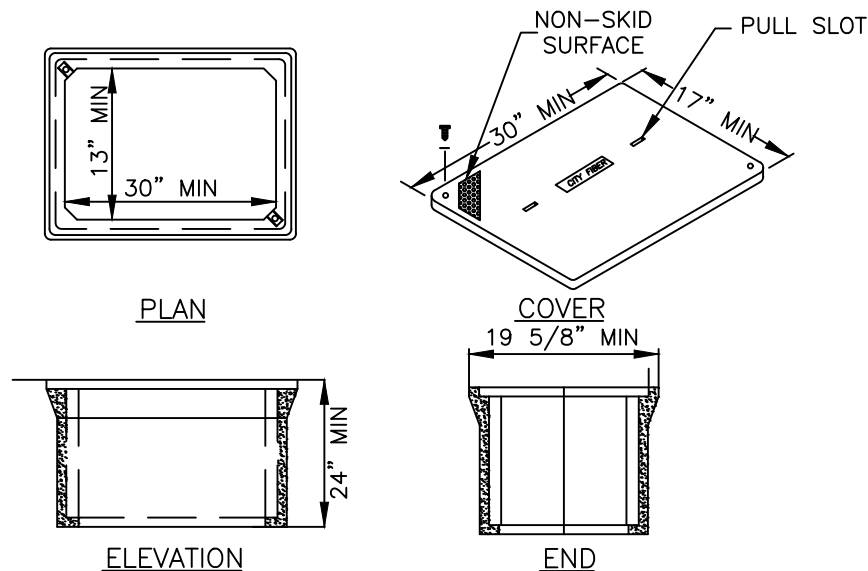

BOX NOTES:

1. JUNCTION BOX IN AREAS SUBJECT TO VEHICLE TRAFFIC SHALL BE CONCRETE OLDCASTLE SYNERTECH COMPOSITE 1730-24/2436-24 UNLESS OTHERWISE SPECIFIED OR APPROVED. BOX SHALL BE 14K LOAD RATED AND MEET ASTM C857 A-12 LOADING SPECIFICATIONS.
2. JUNCTION BOX IN AREAS NOT SUBJECT TO VEHICLE TRAFFIC AND OUTSIDE PAVED AREAS SHALL BE OLDCASTLE CARSON PLASTIC 1730-24/2436-24 UNLESS OTHERWISE SPECIFIED OR APPROVED. BOX SHALL BE 4K LOAD RATED AND MEET ASTM C857 LOADING SPECIFICATIONS.

	STANDARD DRAWING TITLE		DRAWING NUMBER
	CITY FIBER JUNCTION BOX		FO-3
	Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.	SCALE	DATE
		N.T.S.	MAY '18