


SIDEWALK WITH PLANTER STRIP
(FOR ALL NEW CONSTRUCTION)

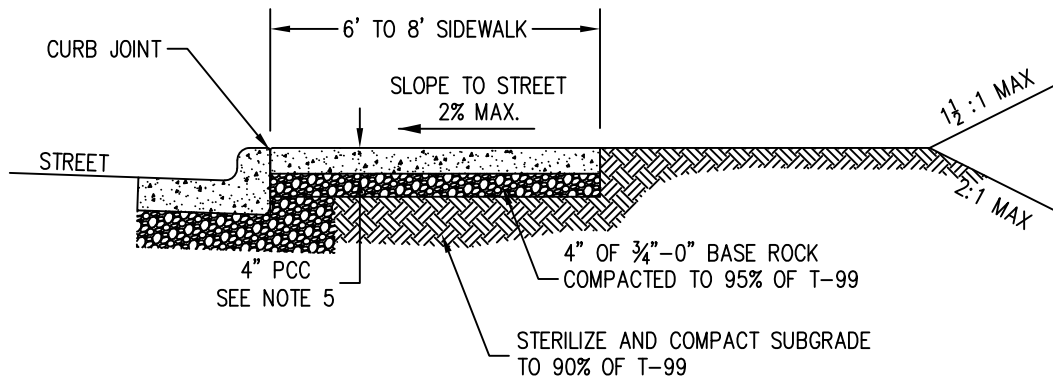

CURB-TIGHT SIDEWALK
(TO BE USED WITH VARIANCE ONLY)

NOTES:

1. CONCRETE SHALL BE COMMERCIAL MIX, MIN. COMPRESSIVE STRENGTH OF 3,300 PSI @ 28 DAYS, WITH A 4" MAX SLUMP.
2. SIDEWALK PANELS TO BE SQUARE (6' LONG x 6' WIDE TYP.).
3. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS, CURB RAMPS, AND/OR POINTS OF TANGENCY IN CURB AS SHOWN ON THE STANDARD DRAWINGS FOR SIDEWALK RAMPS, AND AT SPACING NOT TO EXCEED 45'.
4. FOR SIDEWALKS ADJACENT TO THE CURB AND POURED AT THE SAME TIME AS THE CURB, THE JOINT BETWEEN THEM SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS.
5. SIDEWALKS SHALL HAVE A MINIMUM THICKNESS OF 4". IF MOUNTABLE CURB IS USED, OR IF SIDEWALK IS INTENDED AS PORTION OF A RESIDENTIAL DRIVEWAY IT SHALL HAVE A 6" MINIMUM THICKNESS, COMMERCIAL 8".
6. CONCRETE SHALL HAVE A BROOM FINISH, ALL JOINTS SHALL BE EDGED WITH 3" SHINE.
7. WIDTH OF PLANTER STRIP IS MEASURED FROM FACE OF CURB.
8. IF DRAIN BLOCKOUTS IN CURBS ARE APPROVED, THEY SHALL BE EXTENDED PERPENDICULAR TO CURB TO 1' PAST BACK OF SIDEWALK WITH A 3" DIAMETER ADS PIPE. CONTRACTION JOINT SHALL BE PLACE OVER PIPE.



STANDARD DRAWING TITLE

DRAWING NUMBER

SIDEWALK DETAIL

RD-26

Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.

SCALE

REVISION DATE

N.T.S.

2023.03.17