


**NOTES:**

1. SEE DETAIL W-21 FOR VALVE AND CONNECTION.
2. PROVIDE 3 FT CLEAR SPACE AROUND CIRCUMFERENCE OF HYDRANT.
3. PLACEMENT OF CONCRETE AROUND FIRE HYDRANT IS PROHIBITED.
4. PUBLIC HYDRANTS SHALL BE YELLOW ABOVE GROUND LINE.
5. STORZ ADAPTER REQUIRED ON THE 4½-INCH PORT.
6. HYDRANTS SHALL BE "BREAK AWAY" TYPE AND MEET AWWA C502.
7. HYDRANTS SHALL BE PLUMB IN ALL DIRECTIONS.
8. BLUE REFLECTIVE MARKERS TO BE INSTALLED AT HYDRANT LOCATIONS. THEY SHALL BE LOCATED ADJACENT AND TO THE SIDE OF THE CENTERLINE OF THE ROAD THE HYDRANT IS LOCATED ON.

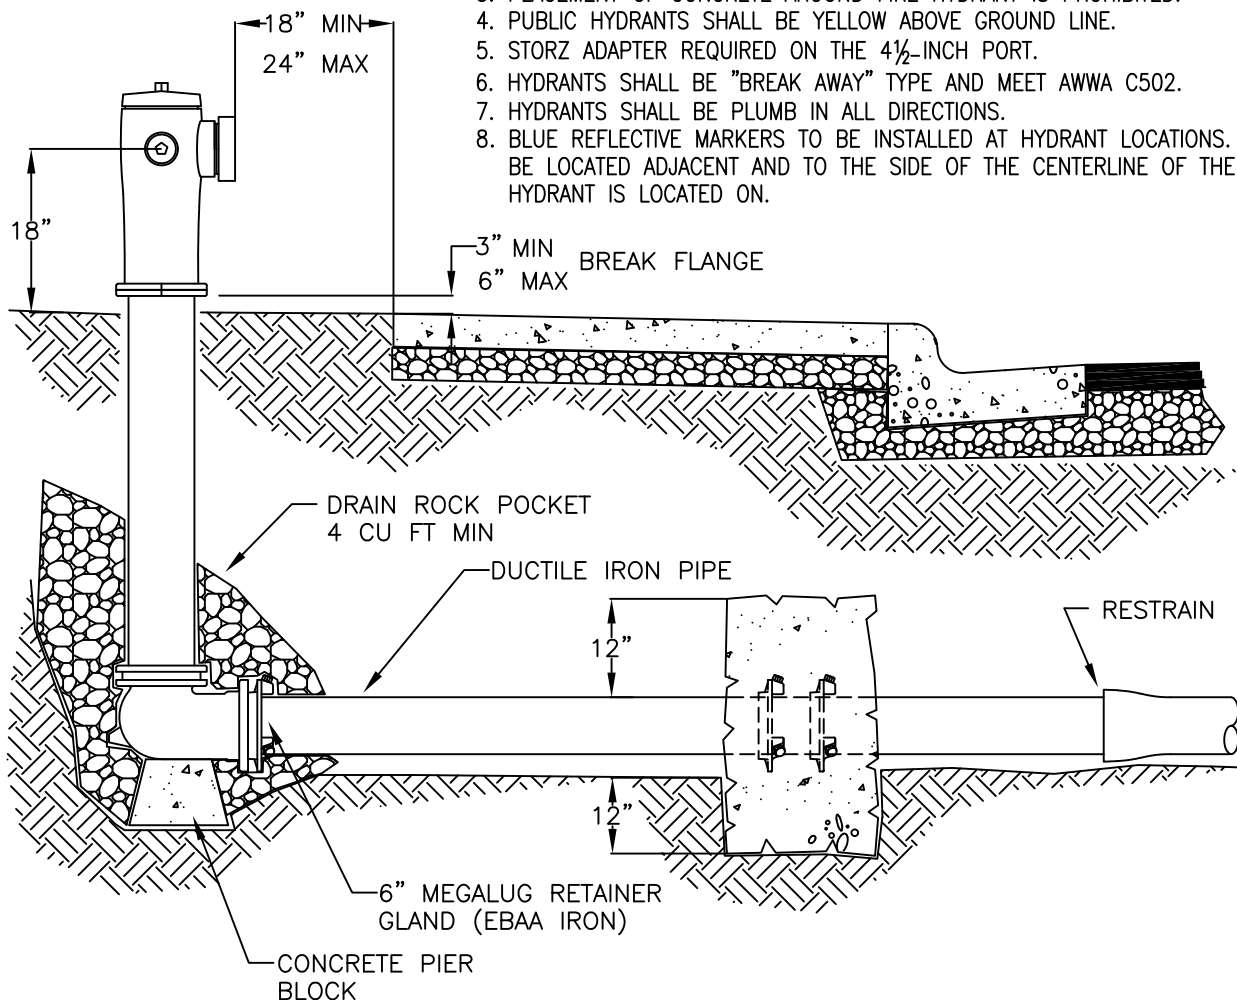

STANDARD DRAWING TITLE

DRAWING NUMBER

FIRE HYDRANT ON DEAD END LINE

W-22

Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.

SCALE

REVISION DATE

N.T.S.

2023.03.17