


PLAN



NOTES:

1. DOUBLE CHECK DETECTOR ASSEMBLY SHALL BE INSTALLED IN A LOCATION APPROVED BY THE CITY
2. DOUBLE CHECK DETECTOR ASSEMBLY SHALL BE INSTALLED HORIZONTAL AND PLUMB
3. ALL CLEARANCES APPLY TO OUTSIDE, IN-BUILDING, AND VAULT INSTALLATIONS
4. INSULATE BLDG AND/OR HAVE A HEAT SOURCE TO KEEP ENCLOSURE AT 40°F (NFPA 13-4-5.4.1.1)
5. ENCLOSURE SHALL INCLUDE A BORE SIGHTED DRAIN TO DAYLIGHT
6. 4" LEVELING COURSE 3/4"-0" COMPACTED GRAVEL
7. A DOOR OR OTHER APPROVED ACCESS SHALL BE PROVIDED
8. ALL ASSEMBLIES 3" AND LARGER SHALL BE FLANGED
9. ALL STRUCTURES TO COMPLY WITH LOCAL BUILDING CODES
10. DETECTOR METER TO READ IN CUBIC FEET

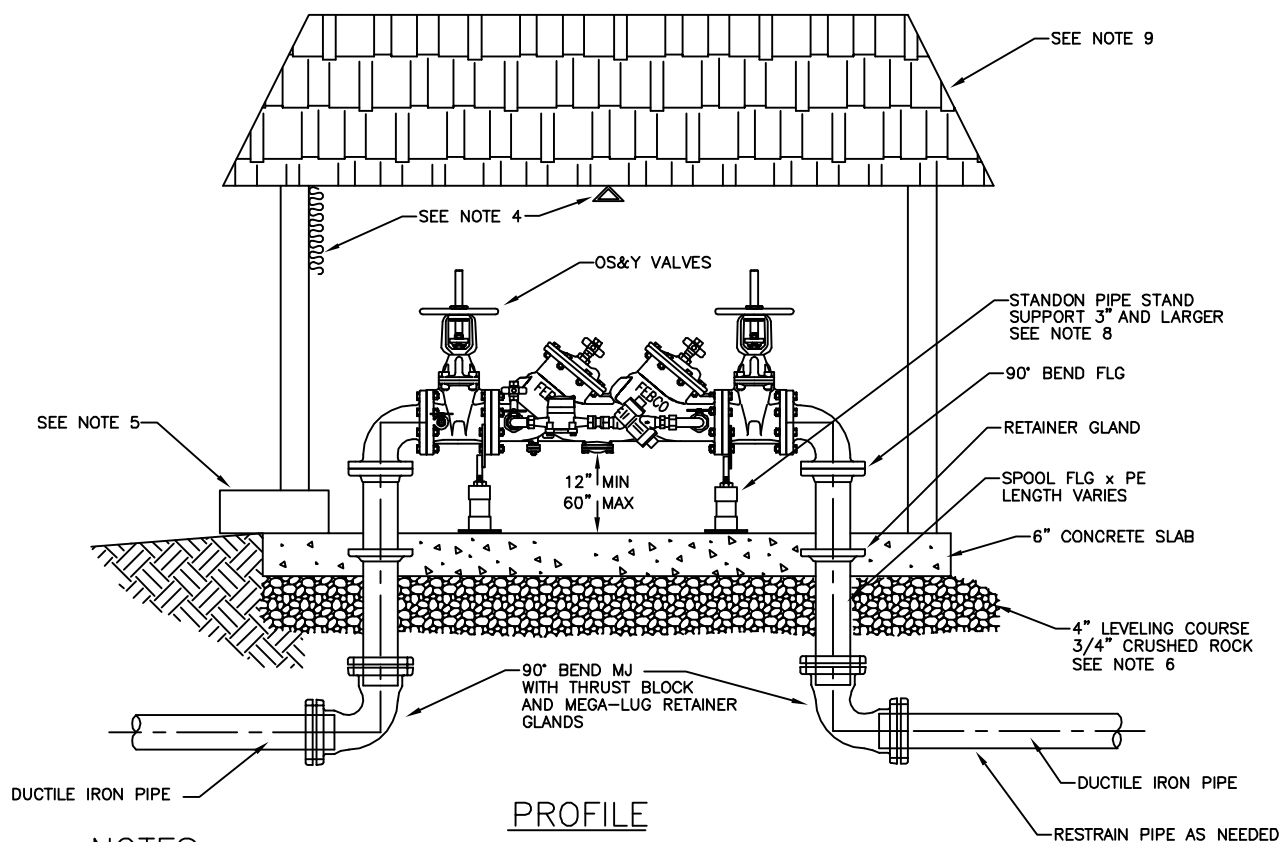

STANDARD DRAWING TITLE

DOUBLE CHECK DETECTOR ASSEMBLY

CUSTOMER OWNED (ABOVE GROUND) 3" THRU 10"

Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.

SCALE

N.T.S.

DRAWING NUMBER

W-79

DATE

JUL' 09