


PLAN

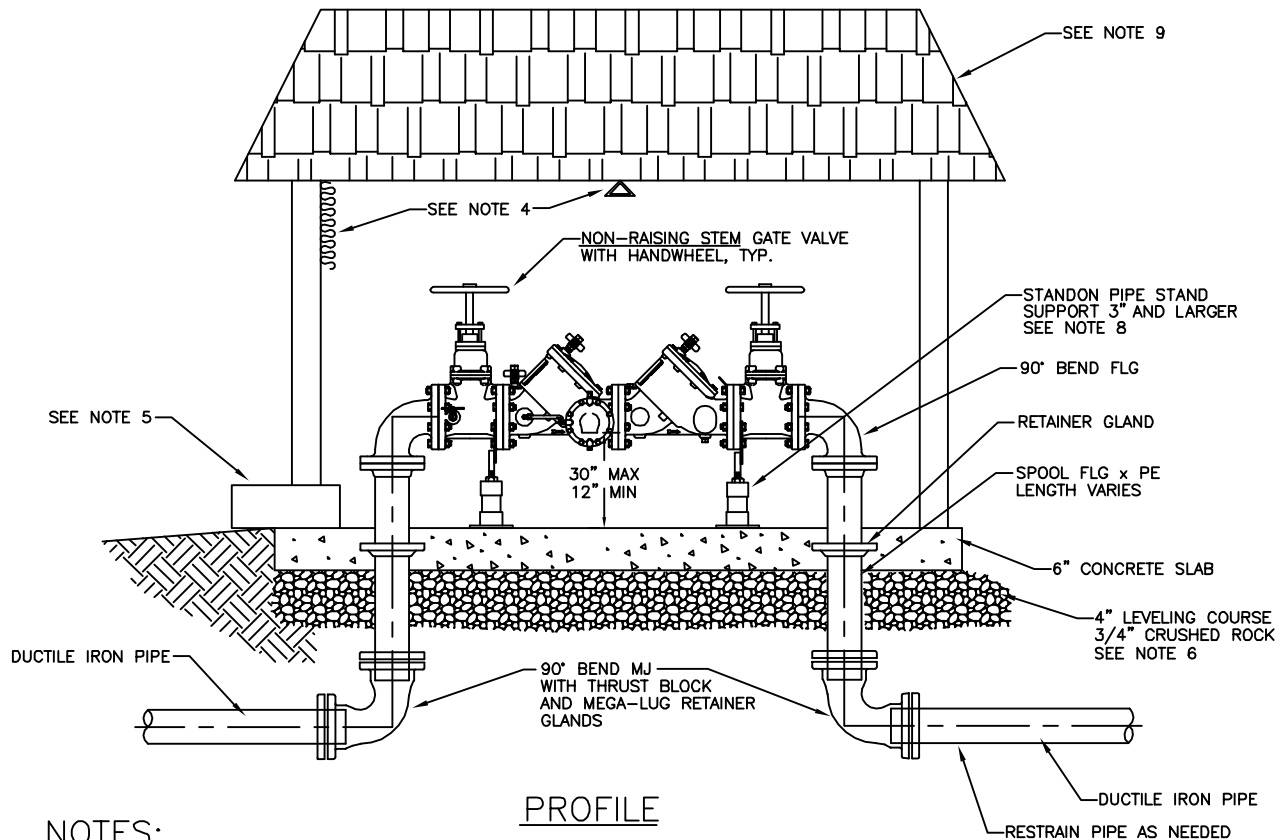

NOTES:

1. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED IN A LOCATION APPROVED BY THE CITY
2. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED HORIZONTAL AND PLUMB
3. ALL CLEARANCES APPLY TO OUTSIDE, IN-BUILDING, AND VAULT INSTALLATIONS
4. INSULATE BLDG. AND/OR HAVE A HEAT SOURCE TO KEEP ENCLOSURE AT 40°F (NFPA 13-4-5.4.1.1).
5. ENCLOSURE SHALL INCLUDE A BORE SIGHTED DRAIN TO DAYLIGHT CAPABLE OF DRAINING A FULL RELIEF VALVE DISCHARGE
6. 4" 3/4"-0" COMPACTED GRAVEL LEVELING COURSE
7. A DOOR OR OTHER APPROVED ACCESS SHALL BE PROVIDED
8. ALL ASSEMBLIES 2 1/2" AND LARGER SHALL BE FLANGED
9. ALL STRUCTURES TO COMPLY WITH LOCAL BUILDING CODES

PROFILE



STANDARD DRAWING TITLE		DRAWING NUMBER
REDUCED PRESSURE BACKFLOW ASSEMBLY 2-1/2" - 10" CUSTOMER OWNED ( ABOVE GROUND )		W-84
Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.	SCALE	DATE
	N.T.S.	JUL' 09