



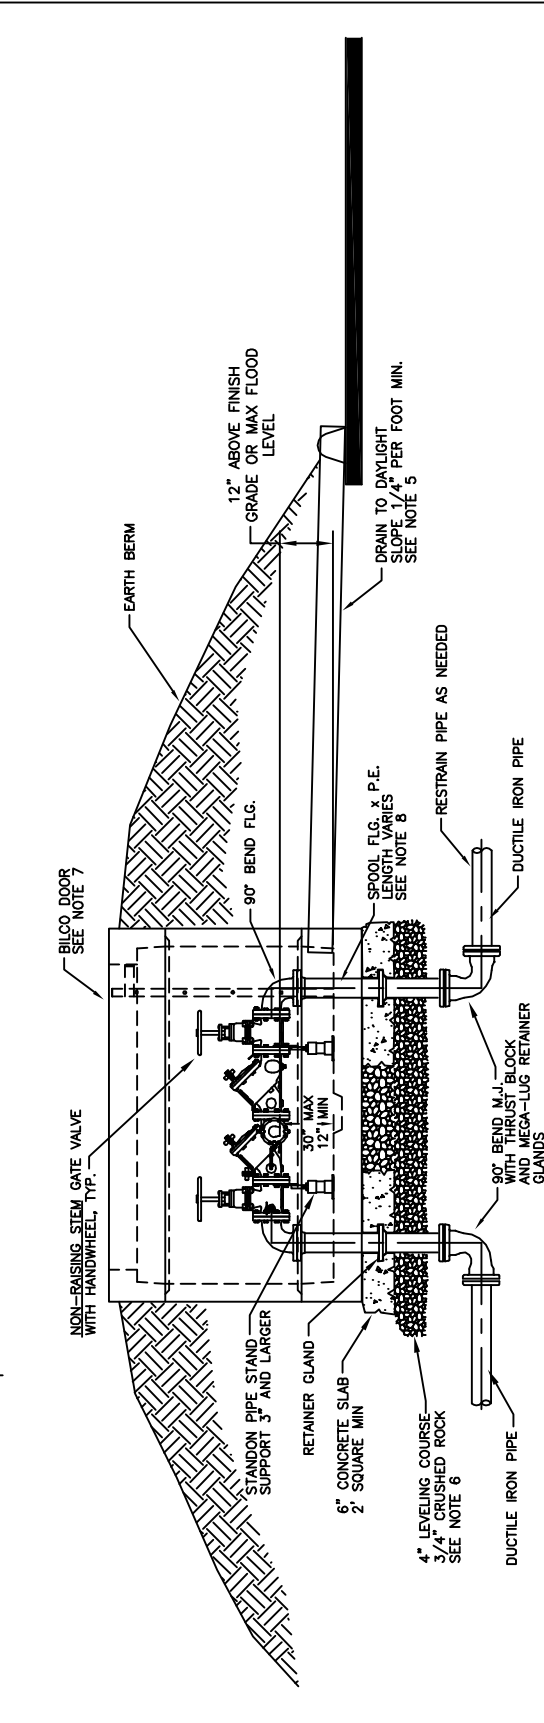

STANDARD DRAWING TITLE	
REDUCED PRESSURE BACKFLOW ASSEMBLY CUSTOMER OWNED (ABOVE GROUND) IN VAULT	
Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.	SCALE
	N.T.S.

DRAWING NUMBER
W-87
DATE
JUL' 09

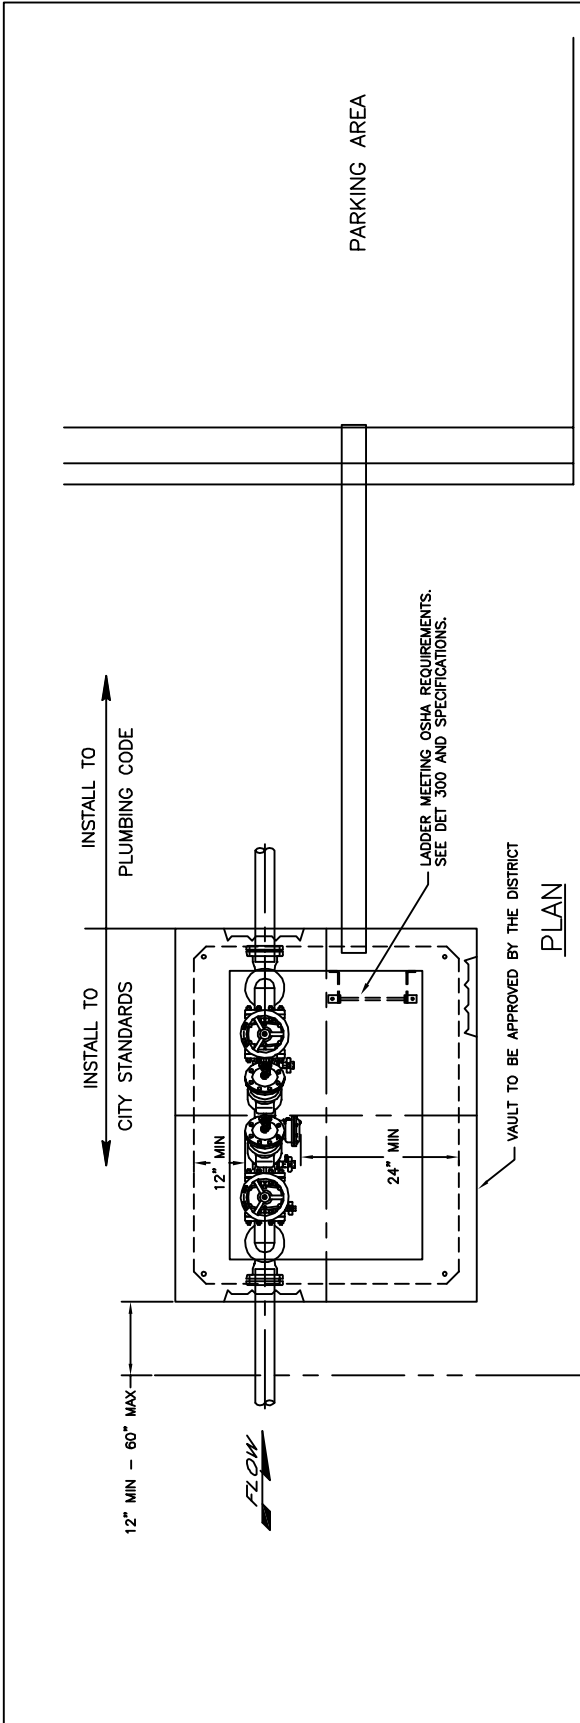

- NOTES:**
1. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED IN A LOCATION APPROVED BY THE CITY
 2. ALL CLEARANCES SHALL BE IN ACCORDANCE WITH THE CITY OF SHERWOOD STANDARD DRAWINGS
 3. VAULT TO BE INSULATED AND/OR HAVE A HEAT SOURCE TO KEEP ENCLOSURE AT 40°F (NFA 13-4-5.4.1.1)
 4. ENCLOSURE SHALL INCLUDE A BORE SIGHTED DRAIN TO DAYLIGHT CAPABLE OF DRAINING A FULL RELIEF VALVE DISCHARGE
 5. 4\"/>
 6. A BILCO DOOR OR OTHER APPROVED ACCESS SHALL BE PROVIDED
 7. ALL ASSEMBLIES 2\"/>
 8. ALL STRUCTURES TO COMPLY WITH LOCAL BUILDING CODES
 9. OPENINGS IN BOTTOM OF VAULT TO BE PRE-FORMED KNOCKOUTS
 - 10.