


SIDEWALK WITH PLANTER STRIP AT CURB



NOTES:

1. FOR CONNECTION TO EXISTING MAINS USE TAPPING SLEEVE IN ACCORDANCE WITH CITY CONSTRUCTION SPECIFICATIONS.
2. PROVIDE A 3 FT CLEAR SPACE AROUND CIRCUMFERENCE OF FIRE HYDRANT.
3. PLACEMENT OF CONCRETE AROUND FIRE HYDRANT IS PROHIBITED.
4. PUBLIC HYDRANTS SHALL BE YELLOW ABOVE GROUND LINE.
5. STORZ ADAPTER REQUIRED ON THE 4½-INCH PORT.
6. HYDRANTS SHALL BE "BREAK AWAY" TYPE AND MEET AWWA C502.
7. HYDRANTS SHALL BE PLUMB IN ALL DIRECTIONS.
8. BLUE REFLECTIVE MARKERS TO BE INSTALLED AT HYDRANT LOCATIONS. THEY SHALL BE LOCATED ADJACENT AND TO THE SIDE OF THE CENTERLINE OF THE ROAD THE HYDRANT IS LOCATED ON.

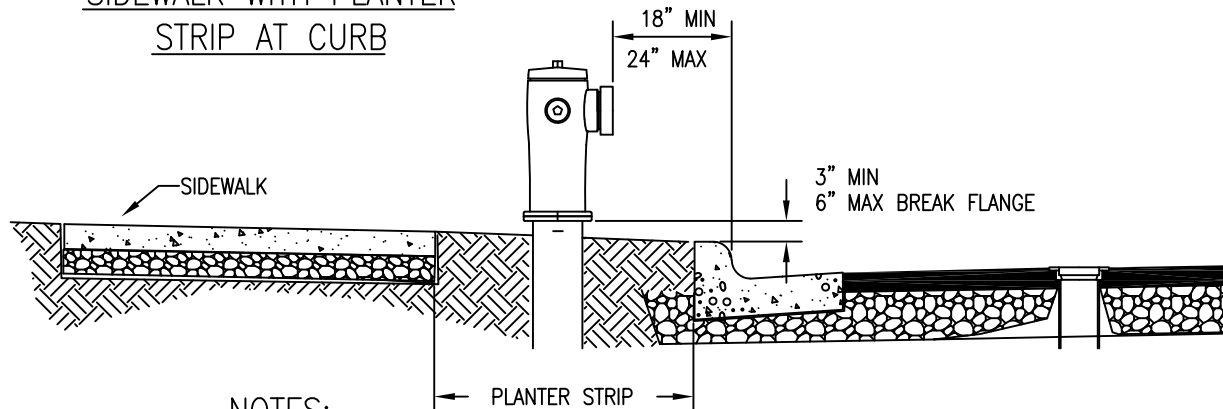

STANDARD DRAWING TITLE

FIRE HYDRANT STANDARD INSTALLATION

Any alteration of this drawing may not be associated in any way with the City of Sherwood Standard Drawings.

SCALE

N.T.S.

DRAWING NUMBER

W-21

REVISION DATE

2023.03.17